


System Design Example

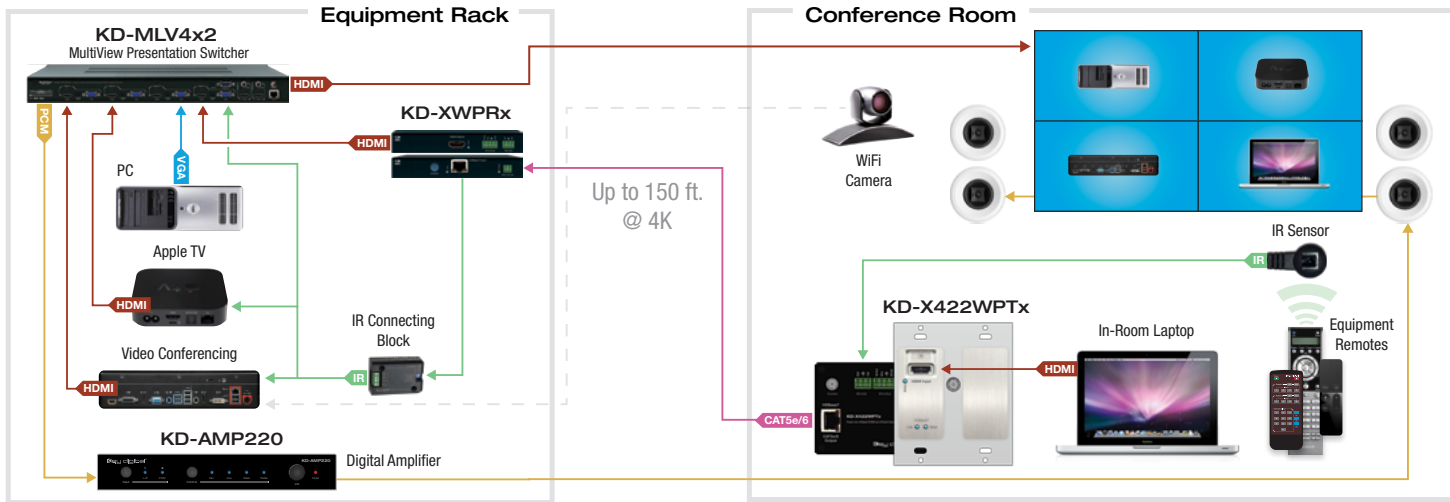

* For all installations, we highly recommend use of KD-CAT6STP1X STP cabling, especially in hostile electrical environments. The shield of CAT6STP must be soldered on both ends to the shield of RJ45 connector used. The CAT5/5e/6 cable has to be terminated according to TIA/EIA-568-B standard. The use of STP CAT5, 5e is not recommended.